

**FIREPRO**




www.firepro.co.nz

**AUCKLAND**  
64 9 579 0367  
**CHRISTCHURCH**  
64 3 379 9364

### Allproof Low Profile Fire Collar inside a Single Layer 13mm Plasterboard Wall Pair Coil, Cable and Conduit

#### INSTALLATION INSTRUCTIONS:

1. Ensure substrate around the service is flat and free from obstructions.
2. Open pipe collar and position around the service. Slide tab through slot in pipe collar and fold back 180° to secure.
3. Slide the collar inside the wall and seal the annular space between the plasterboard and the collar with Allproof MAS310 sealant to a depth of at least 13mm.
4. Secure collar using metal hollow wall anchors fixed directly into the plasterboard. Do not use fixings which rely on plastic or nylon components for grip.
5. Sealant may be applied between the service and the collar as a smoke seal if the service is only pair coil. Otherwise do not seal between service and the collar

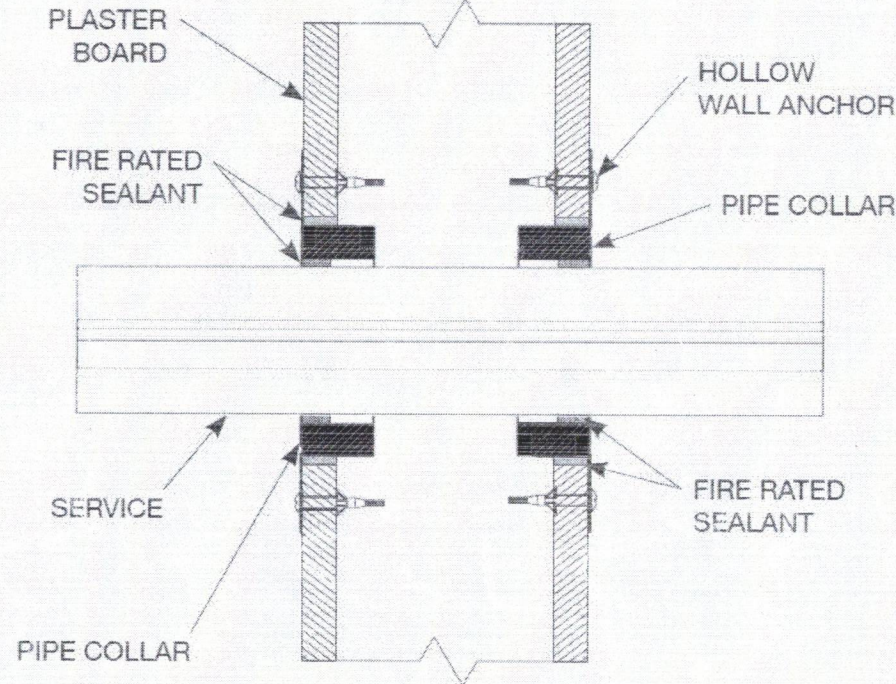

BRANZ Appraisal 1008  
Technical Manual - Electrical Pg 8  
AS1530.4-2014 AS4072.1-2005

System/FPA Register ID# FC633

<b>Products</b>	Allproof Low-Profile Fire Collar
<b>Application</b>	Fire stopping of pair coil in single layer plasterboard wall
<b>Constructio</b>	Minimum wall thickness 90mm with single layer 13mm fire board each side

#### Fire Classification:

Pair Coil with no other services with 50mm collar in max aperture 95mm diam. Sealant may be applied inside the collar as a smoke seal  
FRR -/60/60

Air-con mixed services - pair coil, TPS cable and 20mm PVC DWV (Flexi Hose) with 50mm collar in max aperture 95m diam. Do not apply sealant inside the collar  
FRR-/60/60



BRANZ Appraised  
Appraisal No.1088 (2019)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on [www.firestopcentre.co.nz](http://www.firestopcentre.co.nz)

Signed and approved:

# ALLPROOF

INDUSTRIES

Allproof Industries Ltd  
17 Bay Park Place  
Beach Haven, AK 0626

Sheet size: <b>A4</b>	Drawn date & no: 28/7/21
Scale: <b>NTS</b>	Drawn by: G.P